

EQUIPMENT CONNECTION SCHEDULE		SCH. CODE	
UNIT DESIG.	LOAD	PANEL DEVICE RATING (AMPS/POLE)	DISCONNECTING DEVICE AT UNIT (AMPS/POLE)
H.P.	FLA	MCA	FUS/TAT
GW-1	4	2001	T
GW-2	4	2001	T
RCP-1	1		T
FUR-1	1		T
FUR-2a	3/4		T
FUR-2b	3/4		T
FUR-3	1		T
CU-1	21		SW
CU-2a	15		SW
CU-2b	15		SW
CU-3	21		SW
EF-1	20		T
EF-2	29		T
EF-3	29		T
EF-4	29		T
AC-1	57		SW
AC-2	57		SW
MAU-1	1.5		SW
KEF-1	2		SW
WH-1	2		T

EQUIPMENT CONNECTION SCHEDULE NOTES	
GENERAL NOTES:	
a. ALL CONNECTIONS AND ELECTRICAL EQUIPMENT LISTED IN THIS SCHEDULE SHALL BE PROVIDED AND INSTALLED BY THE ELECTRICAL CONTRACTOR	
b. REFER TO THE MECHANICAL DRAWINGS AND SPECIFICATIONS FOR THE REQUIREMENTS ASSOCIATED WITH WIRING AND CONNECTIONS OF INTERLOCKING, THERMOSTAT LOCATIONS, EXHAUST FAN CONTROL SWITCHES AND OTHER CONTROLS OF MECHANICAL EQUIPMENT.	
SCHEDULE NOTES:	
◇ EXHAUST FAN TO BE CONTROLLED BY LIGHT FIXTURES. COORDINATE ALL REQUIREMENTS WITH MECHANICAL CONTRACTOR PRIOR TO INSTALLATION.	

SPECIAL OUTLET SCHEDULE	
SYMBOL	DESCRIPTION
Ⓐ	CONNECTION TO COOLER/FREEZER DOOR HEATER AND LIGHTS. PROVIDE COMPLETE CONNECTION. VERIFY LOCATION PRIOR TO ROUGH-IN.
Ⓕ	CEILING MOUNTED DUPLEX RECEPTACLE CENTERED ABOVE THE WINDOW. VERIFY LOCATION PRIOR TO ROUGH-IN.
Ⓖ	COMBINATION RECEPTACLE/OUTLET AND USB CHARGER. 20A 125V, 2POLE, 3 WIRE GROUNDING TAMPER RESISTANT RECEPTACLE/OUTLET. LEVITON #15830. RECEPTACLE TO BE MOUNTED HORIZONTALLY AT 36" AFF.
Ⓕ	PROVIDE NEMA 14-20R RECEPTACLE FOR CONNECTION TO COFFEE BREWER. COORDINATE EXACT ELECTRICAL REQ. WITH COFFEE MANUF.
Ⓕ	PROVIDE NEMA 14-30R RECEPTACLE FOR POWER CONNECTION TO SELF-SERVE DELI CASE. COORDINATE EXACT ELECTRICAL REQUIREMENTS WITH EQUIPMENT PROVIDED.
Ⓕ	PROVIDE DUPLEX QUAD RECEPTACLE, COAX-CABLE TV OUTLET, AND DATA DROP WITH (1) CAT 6 CABLE FOR CONNECTION TO FLAT PANEL MONITOR. COORDINATE EXACT ROUGH IN LOCATION OF OUTLETS WITH ARCHITECT/OWNER PRIOR TO ROUGH IN.
Ⓕ	PROVIDE JUNCTION BOX WITH (1) CAT 6 CABLE FOR CONNECTION TO CEILING MOUNTED WIFI ACCESS POINT (ACCESS POINT PROVIDED BY OWNER). COORDINATE EXACT LOCATION WITH OWNER PRIOR TO ROUGH IN.
Ⓕ	PROVIDE AND INSTALL A FLOOR BOX WITH (2) DUPLEX RECEPTACLES. FLOOR BOX SHALL BE EQUAL TO WIREMOLD RFB2 SERIES. COORDINATE COVER SELECTION WITH ARCHITECT PRIOR TO ORDERING.
Ⓕ	PROVIDE A NEMA 5-30R RECEPTACLE FOR POWER CONNECTION TO CONVECTION OVEN. CONTRACTOR SHALL VERIFY EXACT REQUIREMENTS WITH CONVECTION OVEN MANUFACTURER.

LIGHTING MANAGEMENT DEVICE SCHEDULE	
SYMBOL	DESCRIPTION
Ⓐ	CEILING MOUNTED, PASSIVE INFRARED, 24V OCCUPANCY SENSOR. PROVIDE WITH HUBBELL CONTROL SOLUTION #COMMIRL. PROVIDE UNIVERSAL VOLTAGE POWER PACK AS REQUIRED.
Ⓑ	WALL MOUNTED, PASSIVE INFRARED, LINE VOLTAGE OCCUPANCY SENSOR. EQUAL TO HUBBELL CONTROL SOLUTION #LHRS1.

CU FEEDER SCHEDULE				
FEEDER IDENT.	CONDUCTORS	GROUND SIZE PER SET	ISOLATED GRD. SIZE PER SET	CONDUIT SIZE PER SET
	SETS	QUANT. PER SET	SIZE	
20.X	1	SEE NOTE 'b'	#12	1 1/2"
30.X	1	SEE NOTE 'b'	#10	1 1/2"
40.X	1	SEE NOTE 'b'	#8	3/4"
50.X	1	SEE NOTE 'b'	#6	1"
60.X	1	SEE NOTE 'b'	#4	1 1/4"
70.X	1	SEE NOTE 'b'	#4	1 1/4"
80.X	1	SEE NOTE 'b'	#3	1 1/4"
90.X	1	SEE NOTE 'b'	#2	1 1/4"
100.X	1	SEE NOTE 'b'	#1	1 1/2"
150.X	1	SEE NOTE 'b'	#10	2"
200.X	1	SEE NOTE 'b'	#30	2"
225.X	1	SEE NOTE 'b'	#4/0	2-1/2"
250.X	1	SEE NOTE 'b'	#250 KCMIL	2-1/2"
300.X	1	SEE NOTE 'b'	#350 KCMIL	3"
400.X	1	SEE NOTE 'b'	#500 KCMIL	3-1/2"
450.X	2	SEE NOTE 'b'	#4/0	2-1/2"
500.X	2	SEE NOTE 'b'	#250 KCMIL	2-1/2"
600.X	2	SEE NOTE 'b'	#350 KCMIL	3"
800.X	2	SEE NOTE 'b'	#500 KCMIL	3-1/2"
1200.X	4	SEE NOTE 'b'	#350 KCMIL	3"
1600.X	5	SEE NOTE 'b'	#400 KCMIL	3-1/2"


FEEDER SCHEDULE NOTES:	
a. THIS PROJECT MAY NOT REQUIRE ALL FEEDER TYPES LISTED IN THIS SCHEDULE.	
b. THE NUMBER OF CONDUCTORS WILL BE BASED ON THE FOLLOWING NOTATION AT THE END OF EACH FEEDER TAG:	
EXAMPLE: XXXX.X	
AMPACITY	XXXX.XS: INDICATES THE SERVICE FEEDER SIZE, AND NUMBER OF CONDUCTORS. NO GROUND SHALL BE REQUIRED FOR SERVICE FEEDERS.
	XXXX.2: INDICATES (2) HOT CONDUCTORS (OR 1 HOT + 1 NEUTRAL) FOR SINGLE PHASE CONNECTIONS
	XXXX.3: INDICATES (3) HOT CONDUCTORS FOR THREE PHASE CONNECTIONS (OR 2 HOT + 1 NEUTRAL) FOR SINGLE PHASE CONNECTIONS
	XXXX.4: INDICATES (3) HOT CONDUCTORS & (1) NEUTRAL CONDUCTOR. FOR THREE PHASE CONNECTIONS

LIGHT FIXTURE SCHEDULE		LAMPS		FINISH		MOUNTING		REMARKS	
FIXT LTR	MANUFACTURER	CATALOG NUMBER	NO.	TYPE	NO.	FINISH	NO.	FINISH	REMARKS
A	COLUMBIA	LCAT24-40V/LG-EU	-	40W LED	120	STD	LAY-IN	STD	2x4 DIRECT/INDIRECT
AE	COLUMBIA	LCAT24-40V/LG-EU-ELL14	-	40W LED	120	STD	LAY-IN	STD	
B	JUNO LIGHTING	L6-23401-G2-L600-P-C-L-WH	-	29W LED	120	STD	RECESSED	STD	
BE	JUNO LIGHTING	L6-23401-G2-BR-L600-P-C-L-WH	-	26W LED	120	STD	RECESSED	STD	
C	GM LIGHTING	S4-3080-WH	-	12W LED	120	STD	RECESSED	STD	
D	COLUMBIA	LCAT24-40V/LG-EU	-	40W LED	120	STD	LAY-IN	STD	2x2 DIRECT/INDIRECT
DE	COLUMBIA	LCAT24-40V/LG-EU-ELL14	-	40W LED	120	STD	LAY-IN	STD	
F	BEACON	QSP2-24L-50-4K7-3-UNV-DB	-	53W LED	120	BRONZE	WALL MTD	STD	
FE	BEACON	ESP2-24L-50-4K7-UNV-DB-EH	-	53W LED	120	BRONZE	WALL MTD	STD	
K	WINONA LIGHTING	WLAWC804 SEH1 INT 36LONG AL1A4 40K MVOLT SGW	1	211W LED	120	STD	SURFACE	STD	
K1	TECH LIGHTING	700KJAN-05-C	1	LED	120	STD	TRACK	STD	
P2	LITON LIGHTING	JXL0345SBL-60N1PELD-DLV	1	LED	120	STD	SUSPENDED	STD	
R	CREE LIGHTING	CR4-575L-40K-12-E26	-	LED	120	STD	RECESSED	STD	
RE	CREE LIGHTING	CR4-575L-40K-12-E26	-	LED	120	STD	RECESSED	STD	
T	COLUMBIA	LXEM4-40ML-RFA-9	1	47W LED	120	STD	SURFACE	STD	
T1	COLUMBIA	CWW4-40LWG-1WW-EDU	1	40W LED	120	STD	RECESSED	STD	
U	BEACON LIGHTING	AL-U72NB-2204K6X6UUNV/SF3/WHT	1	220W LED	120	STD	SURFACE	STD	
V	COLUMBIA	LCL4-40HL-EU	1	52W LED	120	STD	SUSPENDED	STD	LED STRIP
W	DUAL LITE	PGZ-HTR	1	LED	120	STD	SURFACE	STD	
SA1	HUBBELL OUTDOOR	CL1-A-90LU-4K-4-105-DB	-	325W LED	208	BRONZE	POLE	STD	
SA2	HUBBELL OUTDOOR	CL1-A-90LU-4K-4-105-DB	-	325W LED	208	BRONZE	POLE	STD	
SA3	HUBBELL OUTDOOR	CL1-A-90LU-4K-4-105-DB	-	325W LED	208	BRONZE	POLE	STD	
XA	DUAL LITE	EVE-U-R-W-E	-	LED	120	WHITE	WALL/CEILING	STD	COMBINATION EXIT/EMERGENCY
XB	DUAL LITE	EVC-U-R-W	-	LED	120	WHITE	WALL	STD	

LIGHT FIXTURE SCHEDULE NOTES	
GENERAL NOTES:	
a. GENERAL CONTRACTOR SHALL PROVIDE FIREPROOFING AROUND RECESSED FIXTURES INSTALLED IN FIRE RATED CEILING PER U.L. REQUIREMENTS. ELECTRICAL CONTRACTOR SHALL COORDINATE.	
b. SEE SPECIFICATIONS FOR LAMP AND BALLAST TYPE. VERIFY LAMP COLOR WITH ARCHITECT PRIOR TO ORDERING.	
c. PROVIDE ARROWS AND FACES AS INDICATED BY THE DRAWINGS.	
d. MANUFACTURERS LISTED IN THIS SCHEDULE OR BY WRITTEN ADDENDUM WILL BE THE ONLY APPROVED MANUFACTURERS TO BID THE LIGHTING FIXTURES FOR THIS PROJECT. CONTRACTORS SHALL BE ABLE TO SUBMIT ALTERNATE PACKAGES AS APPROVED BY ENGINEER AND OWNER.	
LIGHT FIXTURE SCHEDULE NOTES:	
◇ PROVIDE WITH EMERGENCY DRIVER WITH 90 MINUTE BATTERY BACKUP.	
◇ CONTRACTOR TO PROVIDE 100W EQUIVALENT LED SCREW IN LAMP.	
◇ NO SUBSTITUTIONS ALLOWED.	
◇ PROVIDE FIXTURE WITH 20" SQUARE TAPERED POLE.	
◇ COORDINATE MOUNTING LOCATIONS WITH ARCHITECTURAL ELEVATIONS AND SECTIONS.	
◇ PROVIDE TECH LIGHTING "KABLE LITE" TRACK SYSTEM WITH "K-JANE" HEADS TO PROVIDE CONTINUOUS SUPPORT SYSTEM WITH LENGTHS SHOWN ON THE DRAWINGS. PROVIDE MOUNTING HARDWARE, FEED KIT, JOINERS, END CAPS, BLACK COILED CORD, AND SUSPENSION ALL THREAD ROD AS REQUIRED FOR A COMPLETE SYSTEM. PROVIDE NUMBER OF HEADS PER TRACK AS SHOWN ON DRAWINGS. CABLE SEPARATION BE CHOSEN TO WORK WITH SELECTED LIGHT HEAD, POWER FEED SHALL BE CONCEALED IN WALL ON EAST ATRIUM INTERIOR WALL. REFER TO ARCHITECTURAL RCP FOR MORE INFORMATION.	
◇ PROVIDE PAR38 LED REPLACEMENT LAMP EQUAL TO SYLVANIA #LED20PAR38/DIM/830/FL40-78207. CONTRACTOR TO VERIFY THAT LAMP IS COMPATIBLE WITH TRACK HEAD.	
◇ PROVIDE HALO LIGHTING SINGLE CIRCUIT TRACK SYSTEM WITH CONTINUOUS TRACK WITH LENGTHS SHOWN ON THE DRAWINGS. PROVIDE MOUNTING HARDWARE, FEED KIT, JOINERS, END CAPS, BLACK COILED CORD, AND SUSPENSION ALL THREAD ROD AS REQUIRED FOR A COMPLETE SYSTEM. PROVIDE NUMBER OF HEADS PER TRACK AS SHOWN ON DRAWINGS. REFER TO ARCHITECTURAL RCP FOR MORE INFORMATION.	
◇ PROVIDE "MONOPOINT" CANOPY FOR CONNECTION TO PENDANT FIXTURE. PROVIDE MOUNTING HARDWARE, FEED KIT, JOINERS, END CAPS, SUSPENSION CABLE AS REQUIRED FOR A COMPLETE SYSTEM. CONTRACTOR TO COORDINATE SUSPENSION HEIGHT WITH ARCHITECT PRIOR TO INSTALL.	
◇ FLOOD LIGHT TO BE SURFACE MOUNTED TO ROOF USING SLIP FITTER MOUNT. PROVIDE BASE PIECE AS REQUIRED. FLOOD LIGHT SHALL BE MOUNTED SO AS NOT TO COMPROMISE THE ROOFING ASSEMBLY. CONTRACTOR TO ENSURE THAT INSTALLATION ALLOWS FOR WATER TIGHT ROOFING ASSEMBLY. REFER TO ARCHITECTURAL ROOFING PLAN FOR EXACT LOCATIONS OF FIXTURES. FIXTURES TO BE AIMED AT ROOF AND WINDOWS OF ATRIUM.	
◇ PROVIDE MR15 LED REPLACEMENT LAMP EQUAL TO SYLVANIA #LEDMR16/DIM/830/FL35-74042 CONTRACTOR TO VERIFY THAT LAMP IS COMPATIBLE WITH TRACK HEAD.	
◇ PROVIDE COMPATIBLE BACK BOX AS REQUIRED FOR SOUND SURFACE LUMINAIRE.	
◇ FIXTURES TO BE SUSPENDED AT 10'-0" ABOVE FLOOR LEVEL ON MEZZANINE. PROVIDE ALL MOUNTING HARDWARE REQUIRED.	
◇ LIGHT FIXTURE HEAD TO BE MOUNTED TO EXISTING POLE. CONTRACTOR TO PROVIDE AND INSTALL ADAPTER FOR RETROFITTING NEW LIGHT FIXTURE HEAD TO EXISTING POLE.	
◇ PROVIDE LED BATTERY PACK FOR FIXTURE. LED BATTERY PACK SHALL BE EQUAL TO EMERG-LITE #LEDDR-14. CONTRACTOR SHALL REMOVE MOUNT THE LED BATTERY PACK IN AN ACCESSIBLE LOCATION WITH 25" OF THE FIXTURE.	

SYMBOL LIST		
SYMBOL	DESCRIPTION	MOUNTING
Ⓐ	LED FIXTURE & FIXTURE LETTER	CEILING
Ⓕ	LED FIXTURE & FIXTURE LETTER	CEILING
Ⓐ	LED OR H.I.D. FIXTURE & FIXT. LETTER	SURF./RECESSED
Ⓕ	LED OR H.I.D. FIXTURE & FIXT. LETTER	WALLBRACKET
⊗	EXIT FIXT. - SHADING DENOTES FACE(S)	CEIL./WALL
⊗	EMERGENCY LIGHT	CEIL./WALL
⊗	GFCI DUPLEX GROUNDED RECEPTACLE	1'-3" AFF
⊗	DUPLEX GROUNDED RECEPTACLE	1'-3" AFF
⊗	EXTERIOR GFCI RECEPT. WEATHERPROOF	1'-3" AFF
⊗	DOUBLE DUPLEX RECEPTACLE	1'-3" AFF
⊗	SPECIAL OUTLET, SEE SCHEDULE OR AS NOTED	
⊗	OCCUPANCY SENSOR, SEE SCHEDULE OR AS NOTED	
⊗	PHONE/DATA OUTLET	1'-3" AFF
⊗	DATA OUTLET	1'-3" AFF
⊗	CATV OUTLET	1'-3" AFF
⊗	SWITCHED RECEPTACLE	1'-3" AFF
⊗	TELEPHONE OUTLET (P=PAY, 44"(W= 44"))	1'-3" AFF
⊗	SWITCHES (1-POLE, 3-WAY, 4-WAY, PILOT KEY)	4'-0" TO TOP
⊗	PUSH BUTTON	
⊗	JUNCTION BOX	
⊗	FUSTAT	
⊗	BRANCH CIRCUIT PANEL & PANEL DESIG.	6'-6" TO TOP
⊗	H.D. SAFETY SWITCH (AMPS, POLE, VOLTAGE)	6'-6" TO TOP
⊗	STARTER (SIZE, POLE, VOLTAGE)	6'-6" TO TOP
⊗	PLAN NOTE	
⊗	MOTOR	
⊗	CONDUIT RUN W/ CONDUCTORS SEE NOTE #7	CEIL./WALL
⊗	CONDUIT RUN 2 CIRCUIT, SEE NOTE #7	EARTH/FLOOR
⊗	PARTIAL HOMERUN (MULTIPLE LOAD LOCATIONS)	
⊗	FEEDER 30.3 30A CIRCUIT SEE NOTE #7	
⊗	CIRCUIT SUPPLIED FROM EMERGENCY SYSTEM	
⊗	FEEDER IDENTIFICATION, SEE SCHEDULE	
⊗	CT	SEE NOTE #9
⊗	WP	WEATHERPROOF
⊗	EM	ITEM SUPPLIED FROM EMERGENCY SYSTEM
⊗	a,b,c	INDICATES SWITCHING SCHEME
⊗	TP	TAMPER PROOF
⊗	⊗	FIRE ALARM MANUAL STATION
⊗	⊗	COMB. F.A. HORN & VISUAL SIGNAL
⊗	⊗	FIRE ALARM VISUAL SIGNAL
⊗	⊗	AREA SMOKE DETECTOR, SEE GEN. NOTE #11
⊗	⊗	HEAT DETECTOR
⊗	⊗	DUCT DETECTOR
⊗	⊗	MAGNETIC DOOR HOLD OPEN

GENERAL NOTES		
1. VERIFY ALL OUTLET LOCATIONS ON THE JOB PRIOR TO ROUGH-IN.		
2. REFER TO RELATED ARCHITECTURAL, MECHANICAL, AND STRUCTURAL DRAWINGS FOR RELATED INFORMATION.		
3. REFER TO THE SPECIFICATIONS FOR DATA NOT ON THE DRAWINGS.		
4. COORDINATE OUTLET BOX LOCATIONS WITH MASONRY TO MINIMIZE CUTTING OF BRICK OR BLOCK.		
5. WALL MOUNTING HEIGHTS TO CENTERLINE OF DEVICE UNLESS OTHERWISE NOTED.		
6. E.C. SHALL REFER TO MECHANICAL DRAWINGS AND SPECIFICATIONS FOR THE REQUIREMENTS ASSOCIATED WITH WIRING AND CONNECTION OF INTERLOCKING AND CONTROLS OF MECHANICAL UNITS AND THERMOSTAT LOCATIONS.		
7. CONDUIT RUN W/CONDUCTORS AS INDICATED, CONDUIT SIZE AS REQUIRED. CONDUIT RUN TO PANEL DEVICE SIZE AS INDICATED (AMPI/POLE). CIRCUIT WITHOUT INDICATION IS ROUTED TO 20A, 1P, BREAKER. CONDUCTOR COUNT IS NOT SHOWN ON THE DRAWINGS FOR #12 SIZE CONDUCTORS. ELECTRICAL CONTRACTOR SHALL PROVIDE NUMBER OF CONDUCTORS AS REQUIRED FOR CIRCUITING, SWITCHING AND/OR CONTROL AS REQUIRED. ALL REQUIREMENTS OF THE CURRENT NATIONAL ELECTRICAL CODE SHALL BE FOLLOWED FOR CONDUIT FILL AND CONDUCTOR DE-RATING IF APPLICABLE.		
8. EXIT LIGHTS AND EMERGENCY LIGHT FIXTURES WITH BATTERY BACKUP SHALL BE CIRCUITED WITH UNSWITCHED HOT CONDUCTOR FROM AREA LIGHTING CIRCUIT FOR POWER SENSING AND CHARGING. IN ADDITION, PROVIDE SWITCHED CIRCUITS TO ANY REQUIRED EMERGENCY LIGHT FIXTURES REQUIRING SAME FOR LOCAL AREA CONTROL.		
9. "CT" INDICATED ADJACENT TO DEVICE INDICATES DEVICE IS MOUNTED ABOVE BACKSPLASH OF COUNTER TOP. VERIFY EXACT HEIGHT WITH ARCHITECTURAL PLANS AND ELEVATIONS.		
10. A GROUND CONDUCTOR SIZED PER N.E.C. ARTICLE 250 IS REQUIRED IN ALL POWER, RECEPTACLE, AND LIGHTING CIRCUITS. GROUND CONDUCTORS ARE NOT SHOWN ON DRAWINGS.		
11. WHERE AREA SMOKE DETECTORS ARE SHOWN ON THE DRAWINGS ELECTRICAL CONTRACTOR SHALL NOT LOCATE SMOKE DETECTORS CLOSER THAN 4 FEET FROM ANY MECHANICAL AIR SUPPLY OR RETURN DIFFUSER, GRILLE, OR REGISTER PER NFPA. ELECTRICAL CONTRACTOR SHALL COORDINATE WITH OTHER TRADES FOR LOCATION OF DETECTOR.		
12. AT EVERY SMOKE OR FIRE/SMOKE DAMPER ELECTRICAL CONTRACTOR SHALL INSTALL A DUCT SMOKE DETECTOR AND RELAY TO CLOSE DAMPER AND SHUT DOWN ASSOCIATED MECH UNIT ON ACTIVATION OF DETECTOR. REFER TO MECHANICAL PLANS AND SPECIFICATIONS AND/OR MECHANICAL CONTRACTOR FOR LOCATIONS AND CONTROL REQUIREMENTS. PROVIDE 120V. CONTROL POWER AT DAMPER IF REQUIRED. IF REQUIRED BY THE FIRE ALARM SYSTEM SUPPLIER, MECHANICAL CONTRACTOR SHALL MODIFY DUCTWORK WHERE FIRE/SMOKE DAMPERS ARE LOCATED AS REQUIRED TO INSTALL DUCT SMOKE DETECTORS IN THE DUCTWORK AT THE FIRE/SMOKE DAMPER LOCATIONS. NOT ALL SMOKE OR FIRE/SMOKE DAMPERS MAY BE SHOWN ON THE DRAWINGS HOWEVER, ALL SMOKE OR FIRE/SMOKE DAMPERS SHALL BE PROVIDED WITH ABOVE REQUIREMENTS.		

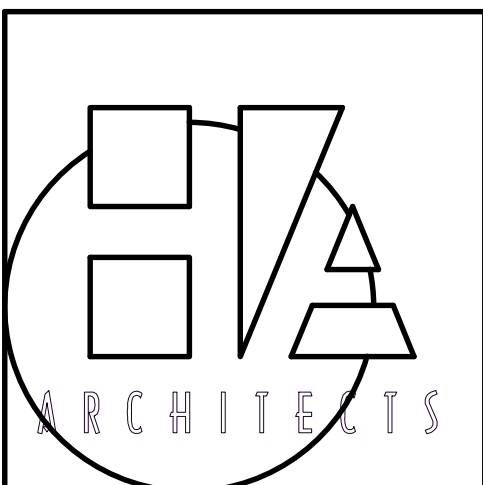

HANNEY & ASSOCIATES, ARCHITECTS
1726 South Hillside, Wichita, Kansas, 67211
Phone (316) 683-8965
Fax (316) 684-1441
www.haarchs.com

2020
24-7 TRAVEL STORE
 24-7 TRAVEL STORE
 2710 Commerce Rd.
 Goodland, Kansas
TRAVEL STORE

DRAWINGS ISSUED		
NO.	DATE	ITEM ISSUED
13	4/15/20	ADDENDUM NO. 2
12	4/09/20	ADDENDUM NO. 1
11	4/01/20	FOR BIDS
10	8/24/20	CHECK SET
9	1/21/20	REVISED PLAN
8	3/20/20	FOR BIDS
7	3/13/20	CHECK SET
6	2/28/20	CHECK SET
5	2/21/20	CHECK SET
4	2/13/20	CHECK SET
3	2/6/20	CHECK SET
2	1/30/20	CHECK SET

COMPUTER DRAWING

DATE: SEPTEMBER 2020
DRAWN BY: CK
CHECKED BY: DR

SHEET
E1.1
OF 1 SHEETS



Integrated Consulting
Engineers, Inc.
349 South Hydraulic • Wichita, KS 67211
316.261.3588 • 316.261.9948 • www.icenginc.com