


HANNEY & ASSOCIATES, ARCHITECTS  
 1726 South Hillside, Wichita, Kansas, 67211  
 Phone (316) 683-8965  
 Fax (316) 684-1441  
 www.haarchitects.com


**2019**  
 OXFORD JUNIOR/SENIOR HIGH SCHOOL  
 UNIFIED SCHOOL DISTRICT #358  
 515 N Water St, Oxford, KS 67119

**RISER NOTES:**

- ① EXISTING PAD MOUNTED TRANSFORMER TO REMAIN AS IS. CONTRACTOR TO COORDINATE REMOVAL OF EXISTING CONDUCTORS WITH LOCAL ELECTRIC UTILITY COMPANY.
- ② EXISTING ELECTRICAL PANEL SHALL BE REMOVED IN ITS ENTIRETY. CONTRACTOR SHALL REMOVE PANEL, ALL DOWNSTREAM CIRCUITS, CONDUITS, AND CONDUCTORS AS REQUIRED BACK TO THE POINT OF ORIGIN. CONTRACTOR SHALL IDENTIFY ANY BRANCH CIRCUITS THAT SHALL NEED TO REMAIN IN PLACE AFTER CONSTRUCTION AND EXTEND EXISTING BRANCH CIRCUITS TO NEW PANELS AS REQUIRED AS A PART OF THIS PROJECT.
- ③ EXISTING PAD MOUNTED TRANSFORMER TO REMAIN AS IS. CONTRACTOR TO COORDINATE THE INSTALLATION AND TERMINATION OF THE NEW CONDUCTORS WITH THE LOCAL ELECTRIC UTILITY COMPANY PRIOR TO BID. COORDINATE ALL REQUIRED DOWNTIME OF THE ELECTRIC SERVICE WITH THE SCHOOL DISTRICT PRIOR TO SHUT DOWN. CONTRACTOR TO VERIFY THAT NEW TRANSFORMER PADMATS AND NEW LUGS ARE PROVIDED FOR NEW AND EXISTING FEEDERS ON SECONDARY SIDE OF TRANSFORMER. ALL FEEDERS SHALL BE SUPPLIED WITH CTS AS REQUIRED FOR METERING.
- ④ PROVIDE TIMECLOCK WITH PHOTOCELL INTERFACE FOR CONTROL OF EXTERIOR LIGHTS. TIMECLOCK SHALL INTERFACE WITH 8-POLE CONTACTOR PANEL VIA LOW VOLTAGE WIRING.
- ⑤ PROVIDE 20A 8-POLE 120V LIGHTING CONTACTOR PANEL FOR CONTROL OF ALL EXTERIOR LIGHTING. CONTACTOR PANEL SHALL HAVE INTERFACE WITH PHOTOCELL AND TIMECLOCK.
- ⑥ CONTRACTOR TO BACK-FEED EXISTING GUTTER AS REQUIRED AS A PART OF THIS PROJECT. CONTRACTOR TO PROVIDE ADDITIONAL JUNCTION BOX AND TERMINAL BLOCKS AS REQUIRED TO BACK-FEED PREVIOUS SERVICE AS A PART OF THIS PROJECT.
- ⑦ EXISTING PANEL 'S' SHALL REMAIN AND BE RE-FEED FROM NEW DISTRIBUTION BOARD 'MSBB'. REFER TO A/E1.2 FOR MORE INFORMATION.
- ⑧ PROVIDE 3#3/0, 1#3/0, & 1#6 G IN 2" CONDUIT FOR FEEDER TO NEW PANEL '1D'. PANEL FEEDER HAS BEEN INCREASED TO ACCOUNT FOR VOLTAGE DROP.
- ⑨ EXISTING FEEDER TO REMAIN AS IS.
- ⑩ EXISTING PANEL TO REMAIN AS IS.
- ⑪ EXISTING GUTTER WAY SHALL REMAIN AS IS. EXISTING DISCONNECTS AND PANELS DOWNSTREAM OF GUTTER SHALL REMAIN AS IS. REFER TO A/E1.2 FOR INFORMATION ON RE-FEEDING THE GUTTER WITH A NEW FEEDER.

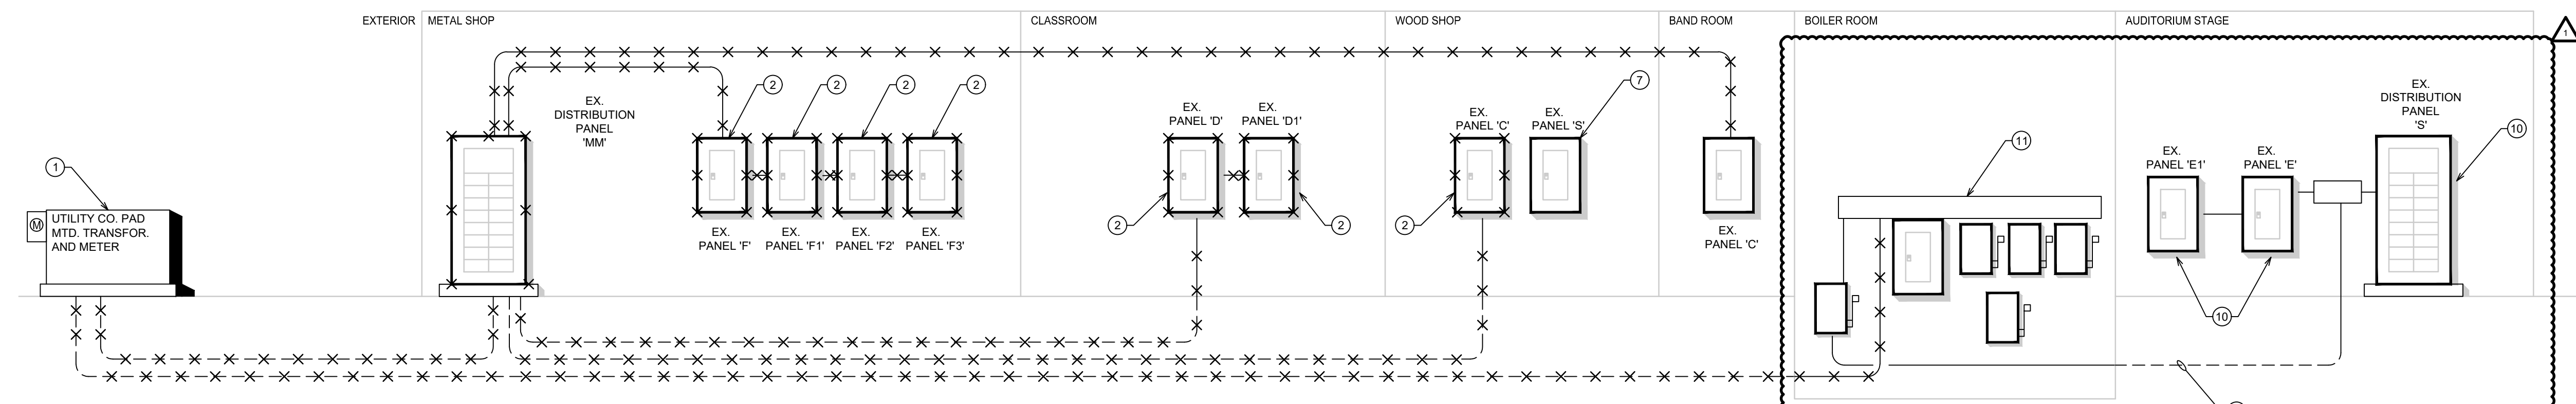

**B DEMO RISER DIAGRAM - INDUSTRIAL ARTS/FINE ARTS BUILDING**  
 SCALE: N.T.S.  
 120208V, 30, 4W.

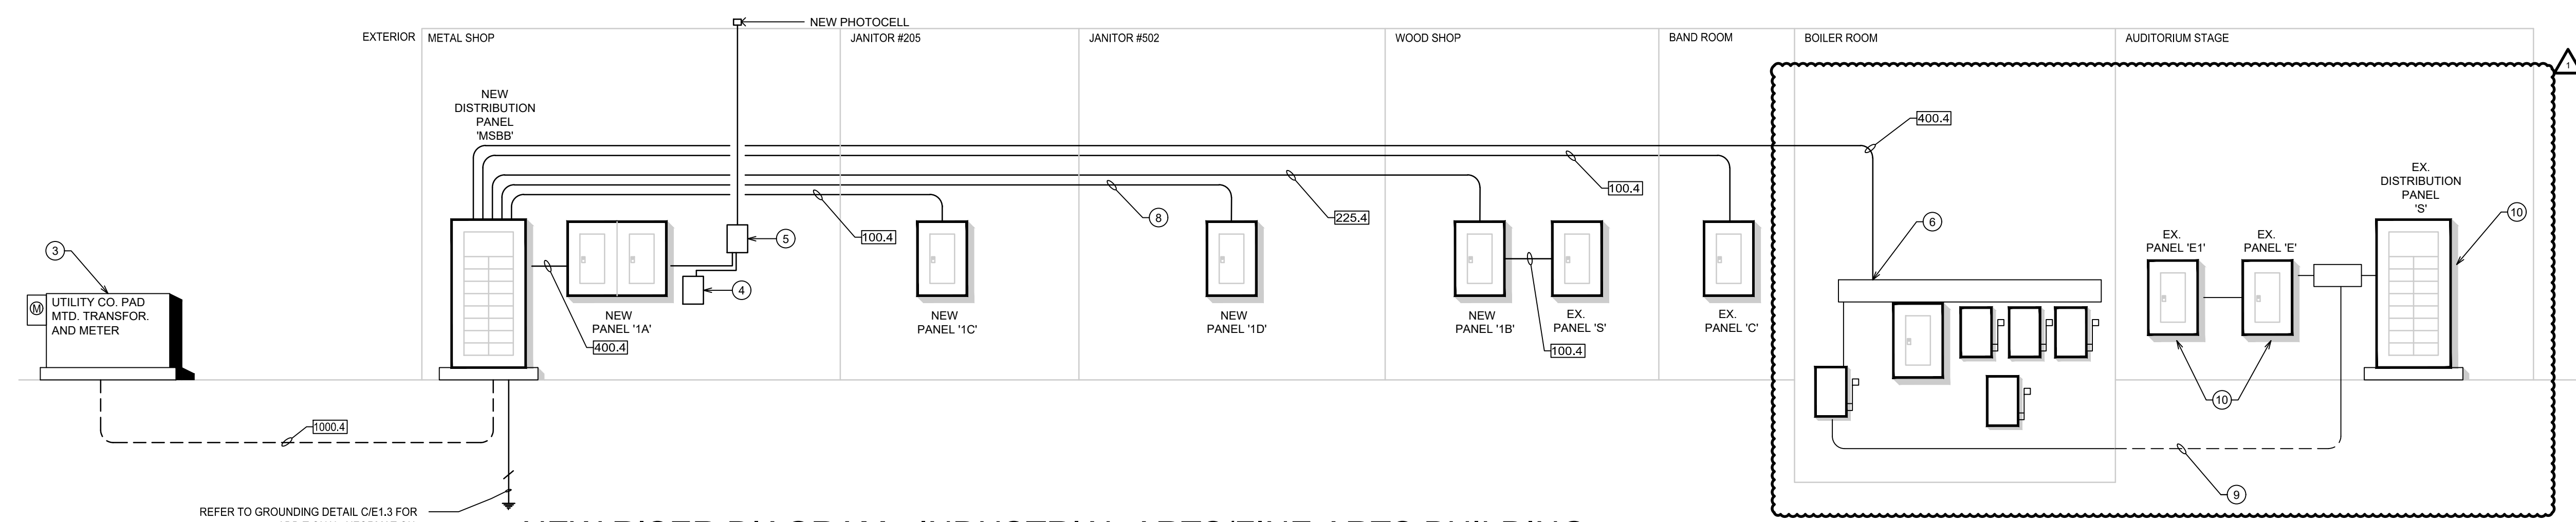

**A NEW RISER DIAGRAM - INDUSTRIAL ARTS/FINE ARTS BUILDING**  
 SCALE: N.T.S.  
 120208V, 30, 4W.

DRAWINGS ISSUED		
NO.	DATE	ITEM ISSUED
8	1/27/20	ADDENDUM #3
7	12/20/19	ISSUED FOR BIDS
6	12/16/19	99% BOARD REVIEW
5	12/13/19	99% SUBMITTAL
4	9/20/19	50% REVIEW
3	6/10/19	DESIGN DEVELOPMENT
2	5/13/19	SCHEMATIC DESIGN
1	4/8/19	SCHEMATIC DESIGN

COMPUTER DRAWING

DATE: AUGUST, 2019  
 DRAWN BY: CK CHECKED BY: DR

SHEET

**E1.2**

OF 1 SHEETS

