KEYED NOTES

1	TPO 60 MIL. ROOFING OR APPROVED EQUAL. - REFER TO SPECIFICATIONS
2	NOT USED
3	ROOFTOP AIR CONDITIONING UNIT, REFER TO HVAC PLANS.
4	PRE-FINISHED METAL COPING W/ CONCEALED FASTENER SYSTEM.
5	CONTINUOUS CANT STRIP
6	LOCATE EXHAUST FANS AND ROOFTOP UNITS MAINTAIN A MIN. 10 FEET CLEARANCE BETWEEN OUTSIDE AIR INTAKE AND EXHAUST DISCHARGE OR PLUMBING VENT. TYPICAL.
7	OUTDOOR AIR FOR ROOF TOP UNITS TO BE BALANCED PER CFM SPECIFIED ON ROOF TOP SCHEDULE.
8	EXHAUST FANS TO MAINTAIN A MIN. CLEARANCE OF 10 FEET FROM THE EDGE OF THE ROOF WHERE REQUIRED BY CODE.
9	MECHANICAL CONTRACTOR TO TERMINATE A PVC/CONSENTRIC VENT THROUGH THE ROOF FOR INSTANTANEOUS WATER HEATER AND INSTALL ACCORDING TO MANUFACTURERS INSTALLATION INSTRUCTIONS.
10	ROOF CRICKET
11	NOT USED

ROOF KEY

AREAS OF NEW ROOF

EXISTING TO REMAIN

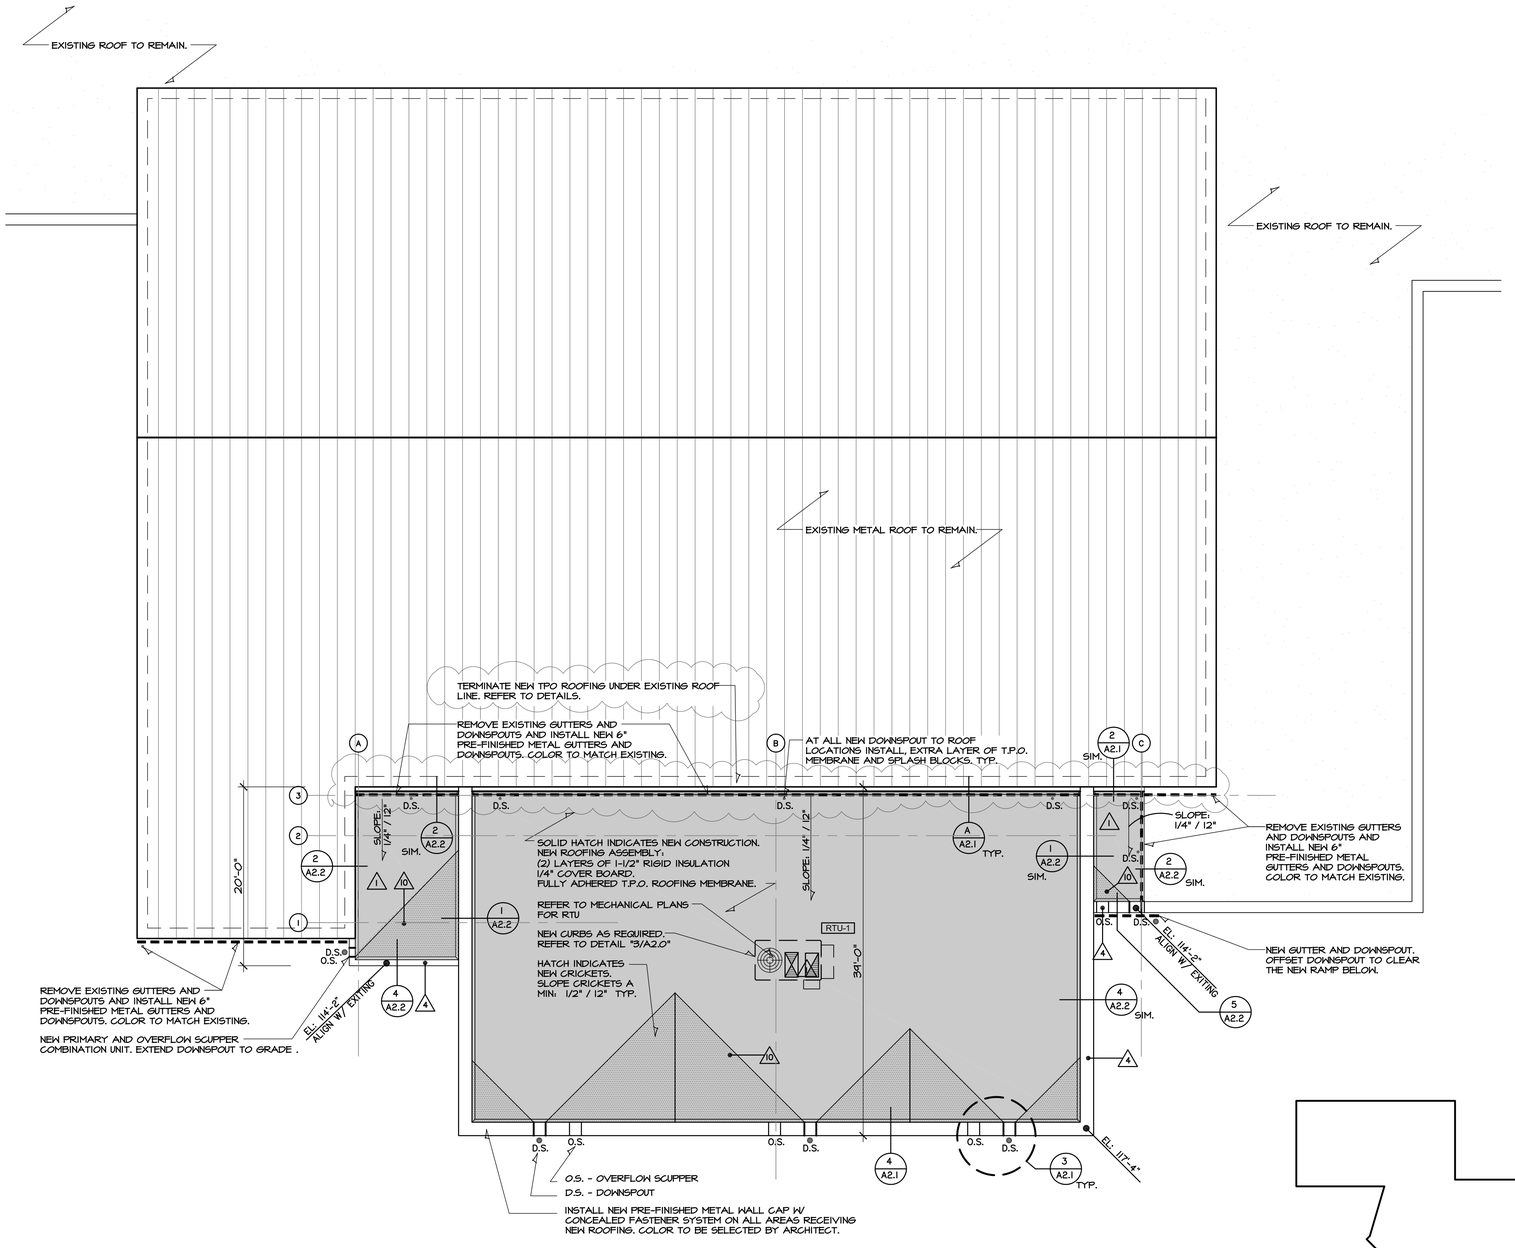

FEMA ADDITION

A ENLARGED ROOF PLAN

SCALE: 1/8" = 1'-0"

NORTH

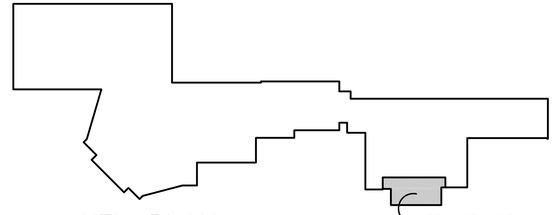

KEY PLAN

ARCHITECTS

MARTIN R. HANNEY LICENSED 3005 KANSAS PROFESSIONAL ARCHITECT

2/18/21

HANNEY & ASSOCIATES, ARCHITECTS
1726 South Hillside, Wichita, Kansas, 67211
Phone (316) 683-8965
Fax (316) 684-1441
www.haarchitects.com

2021 UDALL HIGH SCHOOL
FEMA SHELTER ADDITION
UNIFIED SCHOOL DISTRICT #463

DRAWINGS ISSUED		
NO.	DATE	ITEM ISSUED
8	2/18	ADDENDUM 1
7	1/25	ISSUED FOR BIDS
6	1/11	BOE REVIEW
5	11/24	BOE REVIEW
4	11/9	BOE REVIEW
3	10/26	REVIEW
2	10/16	REVIEW
1	10/08	REVIEW

COMPUTER DRAWING

DATE: OCTOBER 2020	
DRAWN BY:	CHECKED BY:
MH, CH,	MRH

SHEET

A2.3

OF 1 SHEETS