


HANNAY & ASSOCIATES, ARCHITECTS  
 1726 South Hillside, Wichita, Kansas, 67211  
 Phone: (316) 683-8865  
 Fax: (316) 684-1441

2019 GENESIS HEALTH WESTROADS  
 1212 NORTH 162ND STREET  
 OMAHA, NE 68114

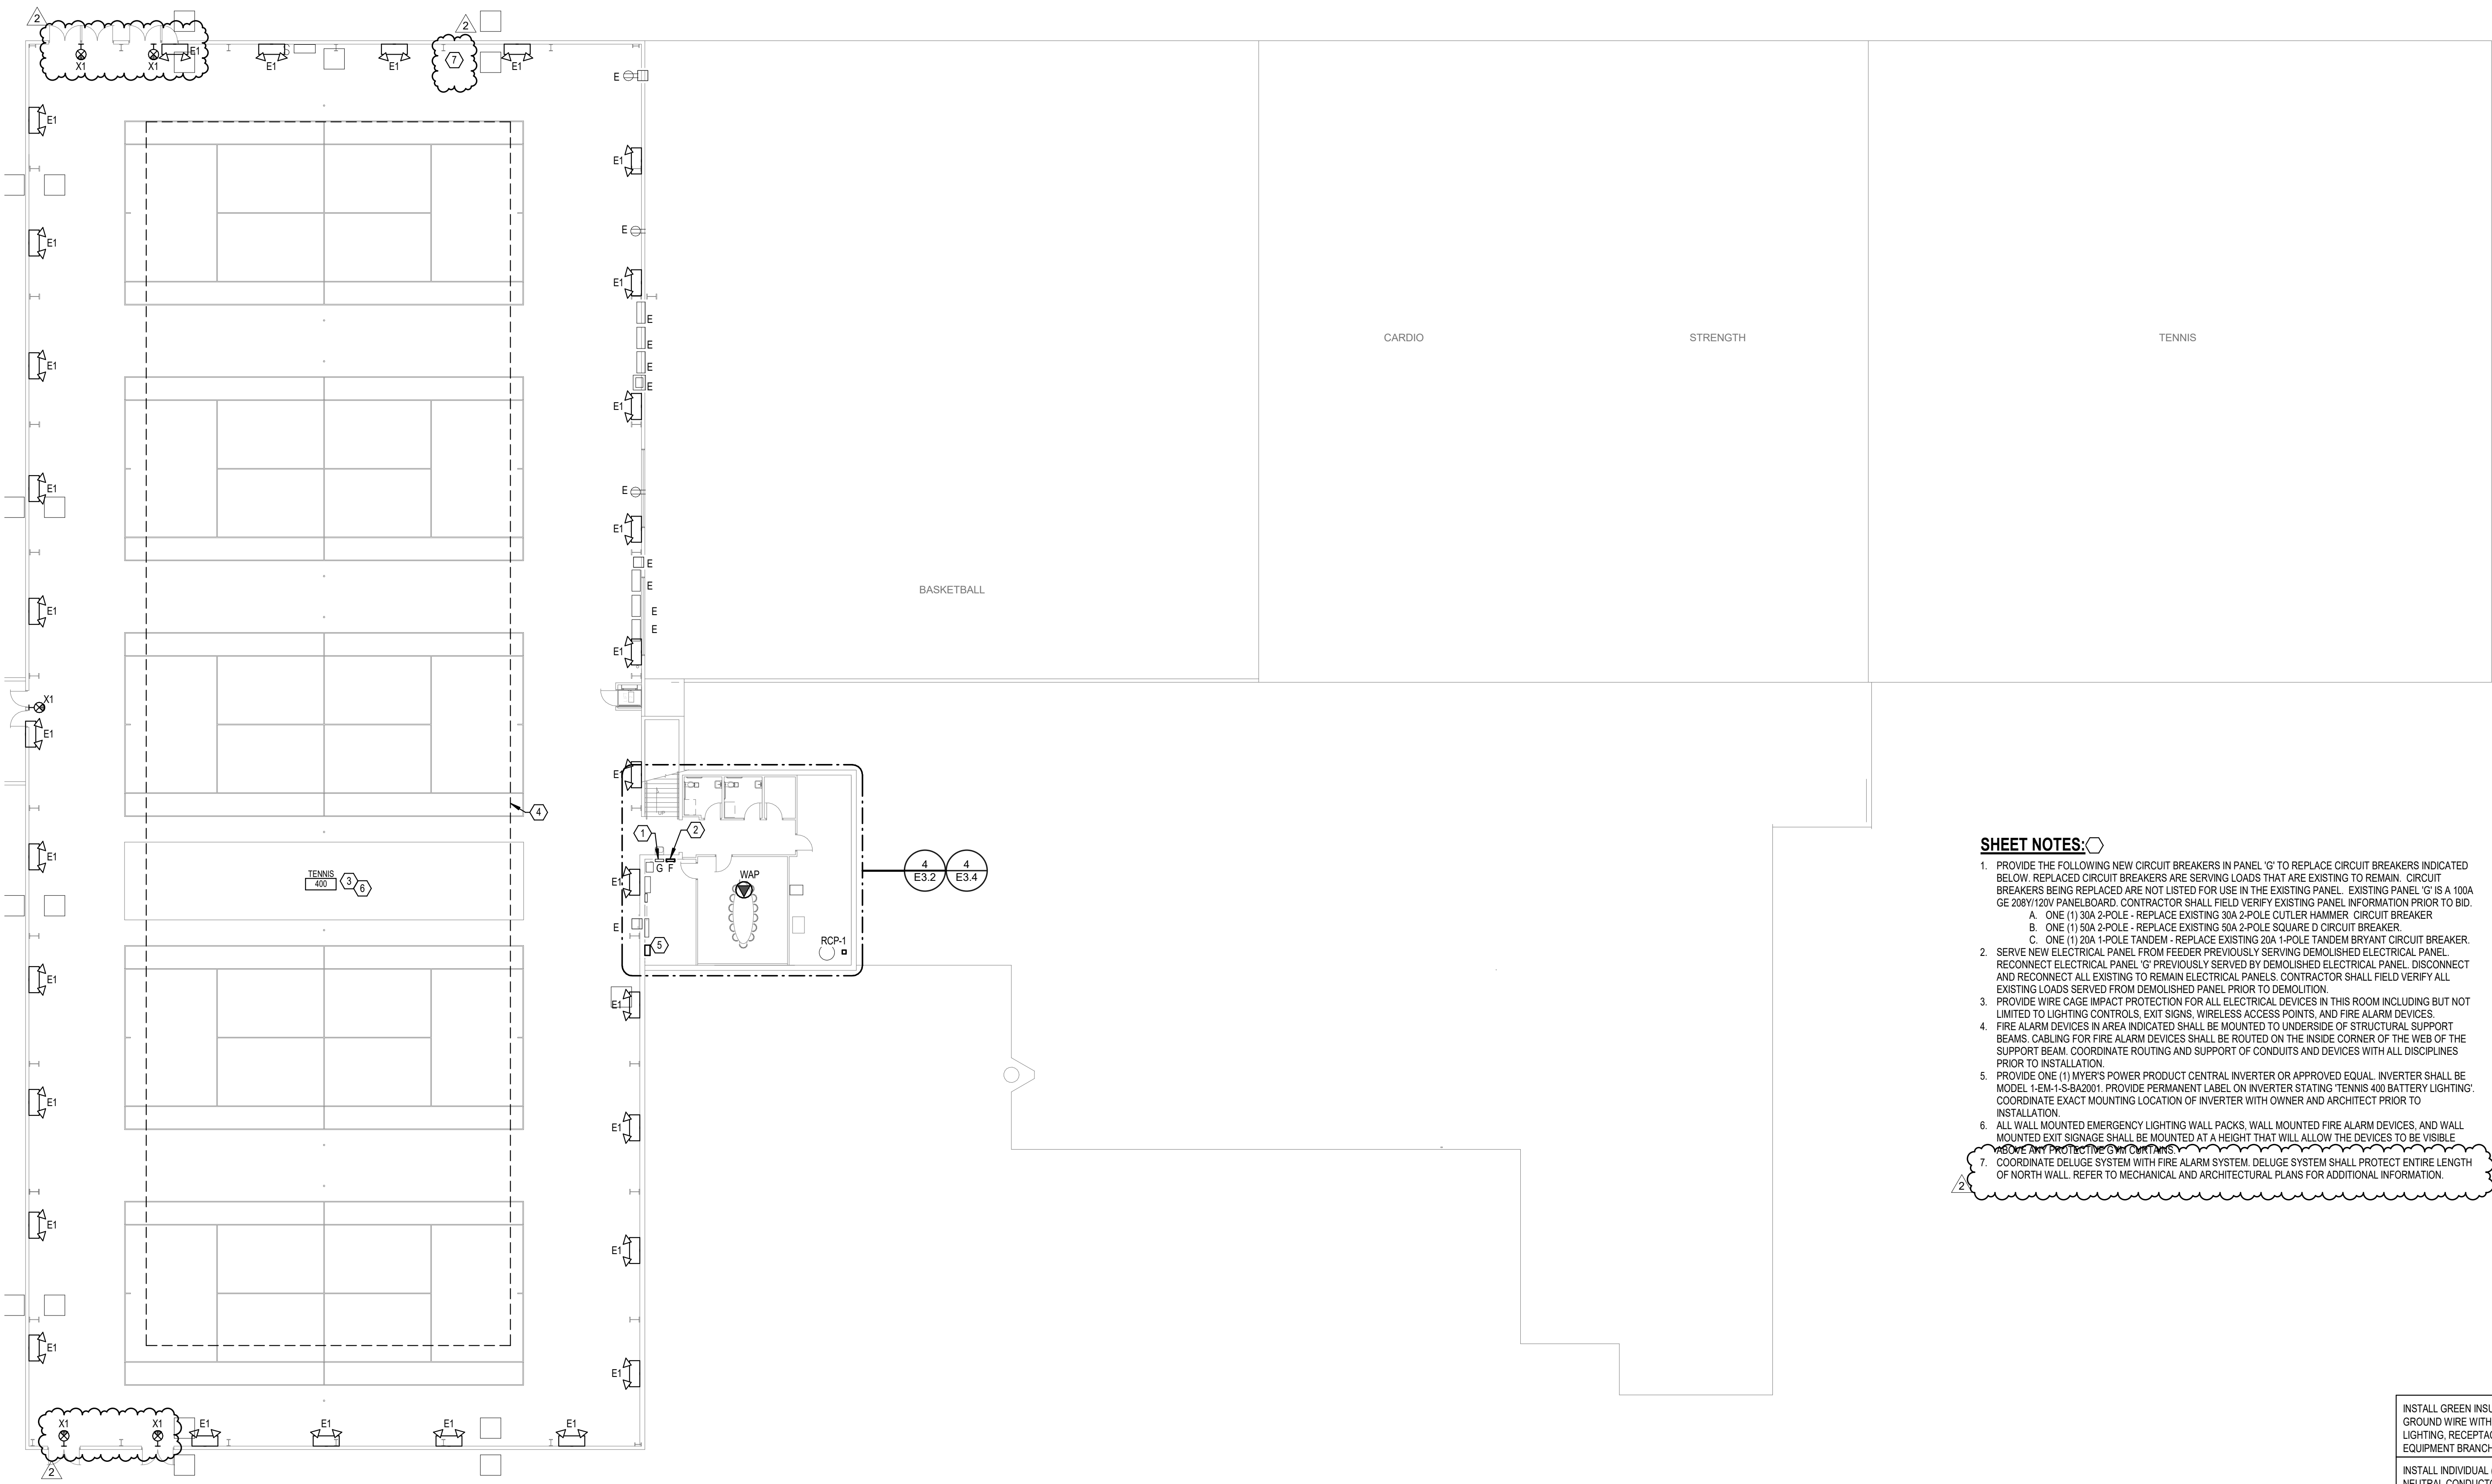

**SHEET NOTES:**

- PROVIDE THE FOLLOWING NEW CIRCUIT BREAKERS IN PANEL 'G' TO REPLACE CIRCUIT BREAKERS INDICATED BELOW. REPLACED CIRCUIT BREAKERS ARE SERVING LOADS THAT ARE EXISTING TO REMAIN. CIRCUIT BREAKERS BEING REPLACED ARE NOT LISTED FOR USE IN THE EXISTING PANEL. EXISTING PANEL 'G' IS A 100A GE 208Y/120V PANELBOARD. CONTRACTOR SHALL FIELD VERIFY EXISTING PANEL INFORMATION PRIOR TO BID.
  - ONE (1) 30A 2-POLE - REPLACE EXISTING 30A 2-POLE CUTLER HAMMER CIRCUIT BREAKER
  - ONE (1) 50A 2-POLE - REPLACE EXISTING 50A 2-POLE SQUARE D CIRCUIT BREAKER
  - ONE (1) 20A 1-POLE TANDEM - REPLACE EXISTING 20A 1-POLE TANDEM BRYANT CIRCUIT BREAKER
- SERVE NEW ELECTRICAL PANEL FROM FEEDER PREVIOUSLY SERVING DEMOLISHED ELECTRICAL PANEL. RECONNECT ELECTRICAL PANEL 'G' PREVIOUSLY SERVED BY DEMOLISHED ELECTRICAL PANEL. DISCONNECT AND RECONNECT ALL EXISTING TO REMAIN ELECTRICAL PANELS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING LOADS SERVED FROM DEMOLISHED PANEL PRIOR TO DEMOLITION.
- PROVIDE WIRE CAGE IMPACT PROTECTION FOR ALL ELECTRICAL DEVICES IN THIS ROOM INCLUDING BUT NOT LIMITED TO LIGHTING CONTROLS, EXIT SIGNS, WIRELESS ACCESS POINTS, AND FIRE ALARM DEVICES.
- FIRE ALARM DEVICES IN AREA INDICATED SHALL BE MOUNTED TO UNDERSIDE OF STRUCTURAL SUPPORT BEAMS. CABLING FOR FIRE ALARM DEVICES SHALL BE ROUTED ON THE INSIDE CORNER OF THE WEB OF THE SUPPORT BEAM. COORDINATE ROUTING AND SUPPORT OF CONDUITS AND DEVICES WITH ALL DISCIPLINES PRIOR TO INSTALLATION.
- PROVIDE ONE (1) MYER'S POWER PRODUCT CENTRAL INVERTER OR APPROVED EQUAL. INVERTER SHALL BE MODEL 1-EM-1-S-BA2001. PROVIDE PERMANENT LABEL ON INVERTER STATING 'GENESIS 400 BATTERY LIGHTING'. COORDINATE EXACT MOUNTING LOCATION OF INVERTER WITH OWNER AND ARCHITECT PRIOR TO INSTALLATION.
- ALL WALL MOUNTED EMERGENCY LIGHTING WALL PACKS, WALL MOUNTED FIRE ALARM DEVICES, AND WALL MOUNTED EXIT SIGNAGE SHALL BE MOUNTED AT A HEIGHT THAT WILL ALLOW THE DEVICES TO BE VISIBLE ABOVE ANY PROTECTIVE COATINGS.
- COORDINATE DELUGE SYSTEM WITH FIRE ALARM SYSTEM. DELUGE SYSTEM SHALL PROTECT ENTIRE LENGTH OF NORTH WALL. REFER TO MECHANICAL AND ARCHITECTURAL PLANS FOR ADDITIONAL INFORMATION.

**DRAWINGS ISSUED**

NO.	DATE	ITEM ISSUED
2	10/04/19	ADDENDUM #2
1	04/22/19	ISSUED FOR BID

**COMPUTER DRAWING**

DATE: APRIL 2019

DRAWN BY: EJR/NLE  
 CHECKED BY: TJH

SHEET

**E1.4**

OF SHEETS

INSTALL GREEN INSULATED GROUND WIRE WITH LIGHTING, RECEPTACLE AND EQUIPMENT BRANCH CIRCUITS.

INSTALL INDIVIDUAL (DEDICATED) NEUTRAL CONDUCTORS FOR EACH 120V OR 277V PHASE CONDUCTOR SERVED FROM A SINGLE POLE CIRCUIT BREAKER

2019 © COPYRIGHT  
 PERMISSION TO REPRODUCE ANY PART OF THIS DOCUMENT IS HEREBY GRANTED SOLELY FOR THE PURPOSE OF THE CONSTRUCTION OF THE PROJECT OR THE ARCHIVING OF THIS PROJECT. UNAUTHORIZED USE OF THIS DOCUMENT WITHOUT THE WRITTEN PERMISSION OF SPECIALIZED ENGINEERING SOLUTIONS IS PROHIBITED BY COPYRIGHT LAW.

DO NOT SCALE DRAWING. ALL DIMENSIONS AND CLEARANCES SHALL BE VERIFIED FROM APPROPRIATE SOURCES. ALL WORK SHALL BE COORDINATED PRIOR TO INSTALLATION. SEE SPECIFICATIONS.

**SPECIALIZED ENGINEERING SOLUTIONS**  
 10360 Ellison Circle  
 Omaha, NE 68134  
 Phone: 402.991.5520  
 www.specializedeng.com

SES PROJECT # 18435

**A OVERALL FOURTH LEVEL FLOOR PLAN - ELECTRICAL**  
 1/16" = 1'-0"



BIM 360//18435 - Genesis Health Club Westroads/18435\_Genesis\_Westroads\_SES\_2017.rvt  
 10/6/2019 5:16:57 PM